


# NCP T27SS

Stainless Steel  
Perimeter Seal



# SEAL



**BHMA**  
CERTIFIED



POSITIVE PRESSURE TESTED GASKETING MATERIALS  
FOR FIRE DOORS FOR APPLICATION TO HOLLOW-  
METAL-TYPE FIRE DOORS RATED UP TO 3 HOURS  
AND WOOD-TYPE FIRE DOORS RATED UP TO 1½  
HOURS, CATEGORY H

SMOKE AND DRAFT CONTROL GASKETING  
(CATEGORY H) TESTED TO UL 1784;  
MEETS REQUIREMENTS OF NFPA 105,  
IBC FOR USE ON "S" LABEL DOORS.

- Stainless Steel Type 304
- Flame/Moisture Resistant
- #6 X ¾" Stainless Steel Sheet Metal Screws Furnished

See [ngpp.com](http://ngpp.com) for All Applicable  
Certifications for this Product.


**ngpp.com**  
**1-800-NCP-RUSH**

---

# INSTALLATION INSTRUCTIONS

---

## 127SS

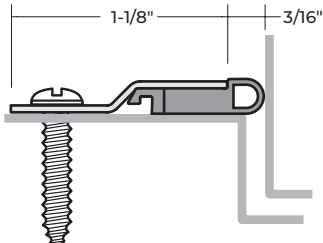

1. Cut seal to fit.
2. With door closed, position seal, Mark screw holes.
3. Drill pilot holes for screws using a  $\frac{7}{64}$ " drill bit.
4. Install with screws provided in all mounting holes, working from one end to the other.
5. Adjust position so that gasket is slightly compressed against door but does not impede proper closing and latching.



[ngp.com](http://ngp.com)

1-800-NGP-RUSH

FAX: (800) 255-7874

QUOTES: [quotes@ngp.com](mailto:quotes@ngp.com)

ORDERS: [orders@ngp.com](mailto:orders@ngp.com)

### MEMPHIS

4985 East Raines Road

Memphis, TN 38118

### CARSON CITY

3689 Arrowhead Drive

Carson City, NV 89706