



139SP

Solid Metal Astragal

PRODUCT CUT SHEET

PROJECT:
SUBMITTED BY:
DATE:
NOTES:

Material

Steel



- ▶ Can Replace Astragal Required by the Door Manufacturer on Wood or Metal Fire-Rated Doors
- ▶ IBC, NFPA80, NFPA 252 Require the Gap at the Meeting Edge Between Fire Labeled Doors Must Not Exceed $\frac{1}{8}$ "
- ▶ Astragal Must Overlap Gap and Inactive Door Minimum of $\frac{3}{4}$ "
- ▶ Furnished with #12 x 1 $\frac{1}{4}$ " SMS

Finishes

139SP Steel Prime Coat
139SPDKB Steel Dark Bronze

Options

- ▶ $\frac{1}{16}$ " Thick Lead Insert Available – Specify "Lead-Lined"
- ▶ Available with SNB, Specify

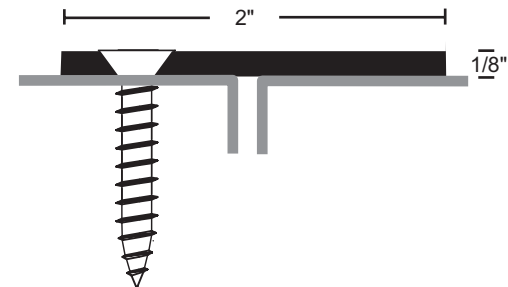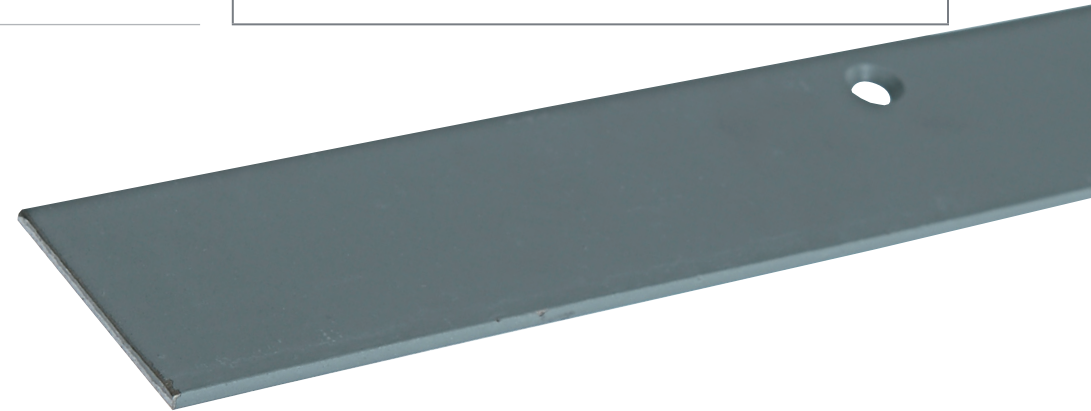

NGP-GKT-139SP-PCS-0226-A

NATIONAL GUARD PRODUCTS, INC.

MEMPHIS

4985 East Raines Road
Memphis, TN 38118

CARSON CITY

3689 Arrowhead Drive
Carson City, NV 89706

Fax: (800) 255-7874

Email: info@ngp.com

Quotes: quotes@ngp.com

Orders: orders@ngp.com

ngp.com
1-800-NGP-RUSH