



139SP

Solid Metal Astragal

PRODUCT CUT SHEET

PROJECT:
SUBMITTED BY:
DATE:
NOTES:

Material

Steel


- ▶ Can Replace Astragal Required by the Door Manufacturer on Wood or Metal Fire-Rated Doors
- ▶ IBC, NFPA80, NFPA 252 Require the Gap at the Meeting Edge Between Fire Labeled Doors Must Not Exceed $\frac{1}{8}$ "
- ▶ BHMA Certified to ANSI/BHMA A156.22 Performance Tests for Heat and Cold
- ▶ Astragal Must Overlap Gap and Inactive Door Minimum of $\frac{3}{4}$ "
- ▶ Furnished with #12 x 1 $\frac{1}{4}$ " SMS

Finishes

139SP Anodized Aluminum
139SPDKB Dark Bronze

Options

- ▶ Available Lead-Lined .030" Thick Lead, Suffix "LD"
- ▶ Available with SNB, Specify

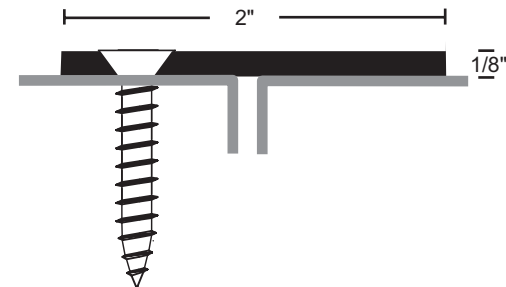

NGP-GKT-139SP-PCS-1220-A