



9220V

Excessive Clearance Door Bottom, Up to 1 1/2" — 20 Minute


For the complete list of GapGuard Fire Door Accessories, the most up-to-date product information and installation instructions, scan the QR code or visit ngp.com.



INSTALLATION INSTRUCTIONS



Provided End Caps

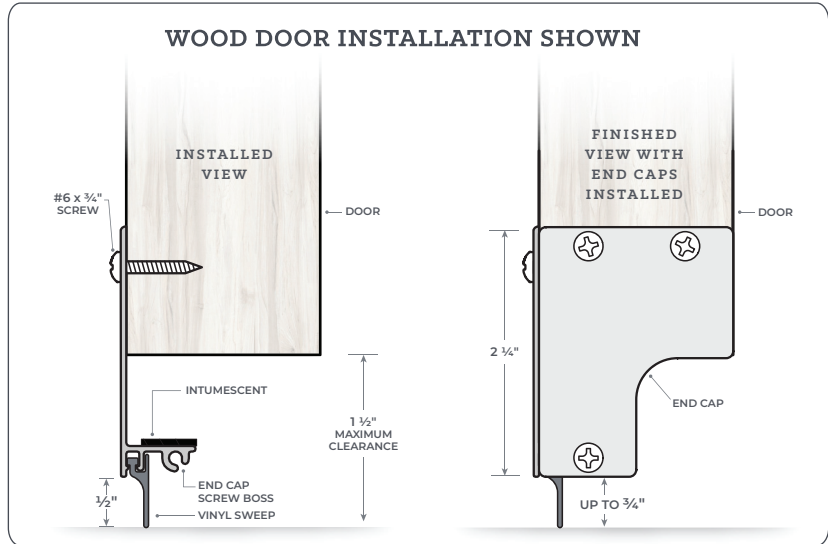

Installation Procedure:

1. Measure and cut door bottom and gasketing insert to fit.
2. Crimp or stake metal retainer at both sides and both ends to prevent gasket from migrating.
3. Close door. Hold sweep at bottom of door. Tap down

4. Mark screw holes.
5. Drill pilot holes for screws using a 7/64" drill bit.
6. Install with screws provided.

7. Adjust position so sweep does not impede proper closing and latching of door.
8. Install end caps, if desired, as illustrated. (Required in Canada.)

For use on up to 20-minute UL10B, UL10C and CAN/ULC-S104 wood or hollow metal fire doors with bottom of door clearance exceeding 3/4", up to 1 1/2".



POSITIVE PRESSURE TESTED
MISCELLANEOUS FIRE DOOR
ACCESSORY
01.26

STORAGE AND SHELF LIFE
The adhesive on this seal has a shelf life of one year stored at 75°F and 50% relative humidity or less

Made in USA

NGP-GAP-9220-PRI-0126-A



MEMPHIS | CARSON CITY

NATIONAL GUARD PRODUCTS, INC.

MEMPHIS
4985 East Raines Road
Memphis, TN 38118

CARSON CITY
3689 Arrowhead Drive
Carson City, NV 89706

Fax: (800) 255-7874

Email: info@ngp.com

Quotes: quotes@ngp.com

Orders: orders@ngp.com

ngp.com
1-800-NGP-RUSH