



9500 Self Adhesive Fire & Smoke Seal

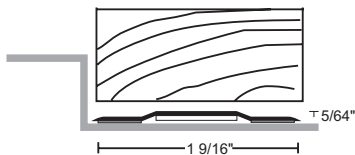

Made in USA



1/8" clearance required between doors or between door and frame

Installation Instructions

1. The surface temperature of the frame must be above 50°F for adhesive to bond.
2. Clean frame with clean wipe provided remove dust, oil, grease and dirt. Wax coated or high gloss painted surfaces may require roughening with a scotch brite pad or sandpaper so adhesive will bond properly.
3. Measure and pre-cut pieces to fit where seal is to be mounted. 1/8" clearance required between door and frame.
4. Remove protective backing 1 to 2 feet at a time.
5. Position on meeting edge of pairs or where illustrated above for perimeter application.
6. Adhere by pressing firmly (approx 15 lbs. pressure required) straight down along entire length of gasketing. Do not remove and relocate.
7. Make sure the seal does not impede proper closing and latching of the door.



POSITIVE PRESSURE TESTED GASKETING MATERIALS
FOR FIRE DOORS
FOR APPLICATION TO HOLLOW-METAL-TYPE FIRE DOORS
RATED UP TO 3 HOURS AND WOOD-TYPE FIRE DOORS
RATED UP TO 1-1/2 HOURS.
CATEGORY G





NGP-EDGE Sealing System (Category G) for perimeter and/or meeting edge use on category B wood type fire doors rated up to 90 minutes, single swing up to 4'0" x 9'0" and pairs up to 8'0" x 9'0"

STORAGE AND SHELF LIFE

The adhesive on this seal has a shelf life of one year stored at 75°F and 50% relative humidity or less

9500 Empaque Cortafuego y Corta Humo Autoadhesivo

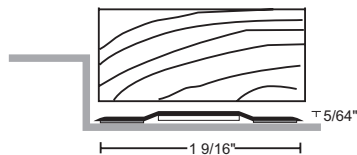

Hecho en
Estados Unidos



Requiere espacios de 1/8" entre puertas o entre la puerta y el marco.

Instrucciones de Instalación

1. La temperatura de superficie del marco debe de estar a más de 50°F para que el adhesivo pegue.
2. Limpie el marco con el paño limpio suministrado para remover polvo, aceite, grasa y tierra. Para que el adhesivo pegue adecuadamente en las superficies enceradas o con pintura de alto brillo puede lijarlas, si es necesario, con una almohadilla Scotch Brite o con papel de lija.
3. Mida y recorte las piezas para adaptarlas donde se van a instalar. Se requiere un espacio de 1/8" entre la puerta y el marco.
4. Retire el papel protector uno o dos pies a la vez.
5. Coloque en la orilla donde las puertas dobles convergen o donde se ilustra arriba para aplicación perimetral.
6. Para adherirlo presione con firmeza (se necesitan aproximadamente 15 libras de presión) a lo largo de todo el empaque. No lo remueva para reubicarlo.
7. Asegúrese que el sello no impida cerrar y correr debidamente el pasador de las puertas.



MATERIAL DE EMPAQUE PARA PUERTAS CORTAFUEGO
SOMETIDOS A PRUEBAS DE PRESION POSITIVA, PARA
USARSE EN PUERTAS METALICAS HUECAS CORTAFUEGO,
CERTIFICADAS HASTA 3 HORAS Y PUERTAS DE MADERA
CORTAFUEGO, CERTIFICADAS HASTA 1-1/2 HORAS
CATEGORÍA G



Sistema de Sellado **NGP-EDGE**® (Categoría G) para usarse en el
perímetro y/o en la orilla donde las hojas convergen en puertas
cortafuego de madera categoría B certificadas hasta 90 minutos, para
puertas sencillas abatibles de hasta 4'0" por 9'0" y dobles de hasta
8'0" por 9'0".

ALMACENAMIENTO Y VIDA ÚTIL

El adhesivo de este sello tiene una vida útil
de un año si se almacena a una temperatura
de 75°F y una humedad relativa de 50%
o menos.