


# HP90-FB

FLUSH BOLT HARDWARE PREP FILLER



UL CERTIFIED FOR USE IN  
THE US AND CANADA

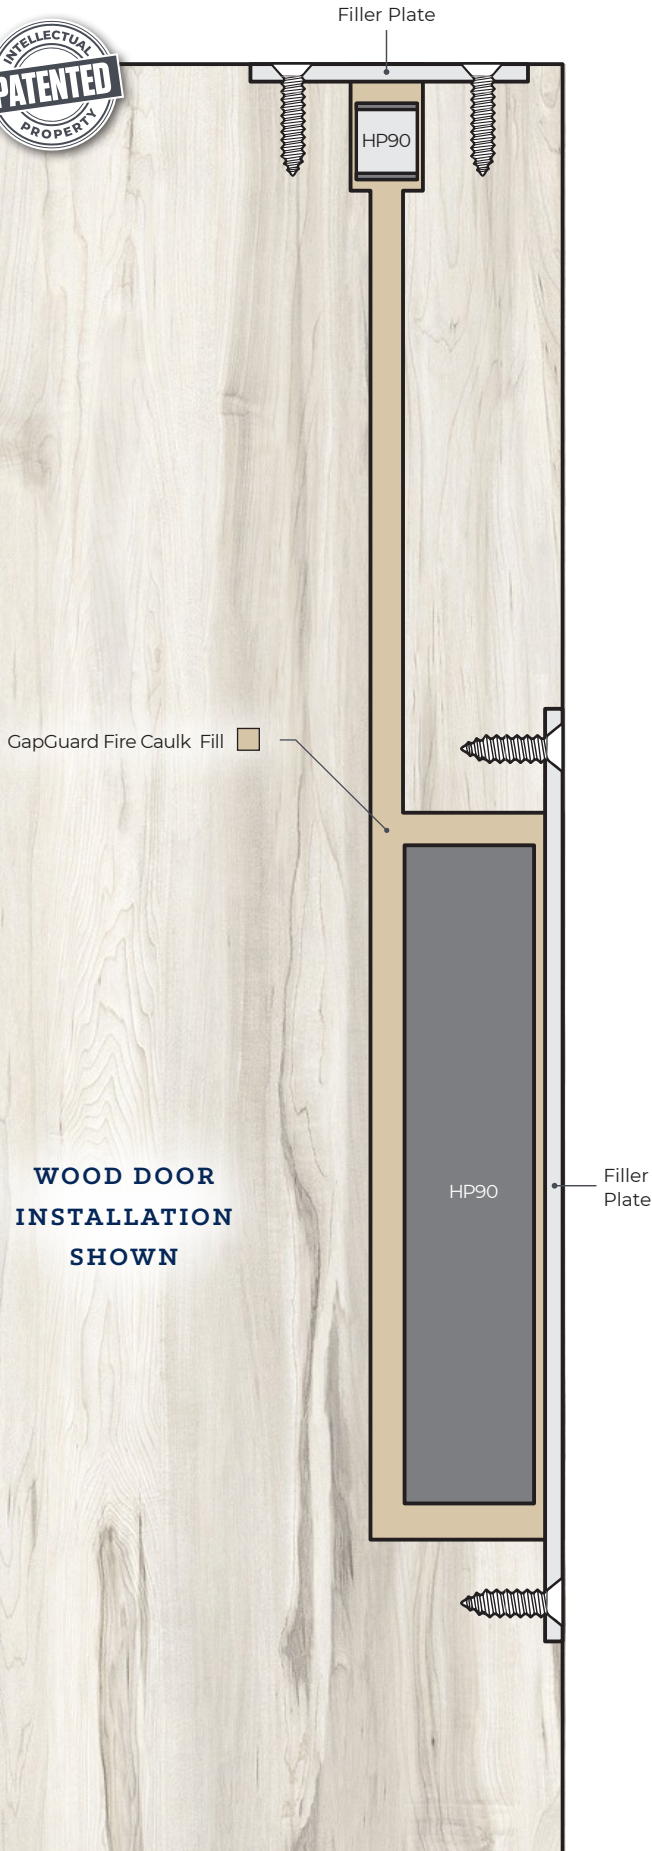

**WOOD DOOR  
INSTALLATION  
SHOWN**

**UL Certified Solution for Fire Doors When  
Either Removing Existing Hardware and/or  
Using a New Hardware Type Over Existing  
Hardware Preps.**

## PRODUCT INFORMATION

- Application Certified On Both Hollow Metal And Wood Fire-Rated Doors Up To 90 Minutes
- Certified for Filling Manual or Automatic Flush Bolt Cavities
- Patented: US Patent US 11,959,332 B2

### PRODUCT CONSISTS OF:

- + HP90 – 2" x 6" Rectangular Fire-Rated Panel
- + HP90 – 0.5 Cylindrical Fire-Rated Panel
- + Steel Filler Plates: *(Powder Coated Primer Gray, Embossed With UL Mark)*
  - HP90-FBE6750, Edge Filler Plate
  - HP90-FBE8500, Edge Filler Plate
  - HP90-FBL2000, Latch Bolt Filler Plate
  - HP90-FBL2500, Latch Bolt Filler Plate
  - HP90-FBL3875, Latch Bolt Filler Plate
  - HP90-SF2250, Strike Filler Plate
- + Hardware Pack
  - #10-32 x 1-3/4" FHPH SS Machine Screw
  - #8 x 3/4" FHPH SS Combo Screw
  - #12 x 1" FHPH SS Combo Screw
  - #8 x 3/4" FHPH SS SMS
  - #12 x 1" FHPH SS SMS
- + GapGuard Fire Caulk  
*(see Installation Instructions)*



POSITIVE PRESSURE TESTED  
MISCELLANEOUS FIRE DOOR  
ACCESSORY



### SPECIAL NOTES:

- 90-Minute Rated UL Certified Miscellaneous Fire Door Accessory on UL10B and UL10C Wood or Hollow Metal Fire Doors
- To Retain UL Certification, the HP90-MORT must be Installed using GapGuard Fire Caulk